




DANGO & DIENENTHAL

Incorporated


HVAC

Filter Applications


USA

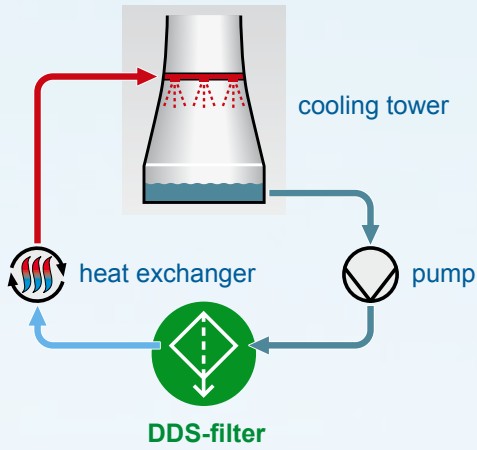

protection of heat exchanger

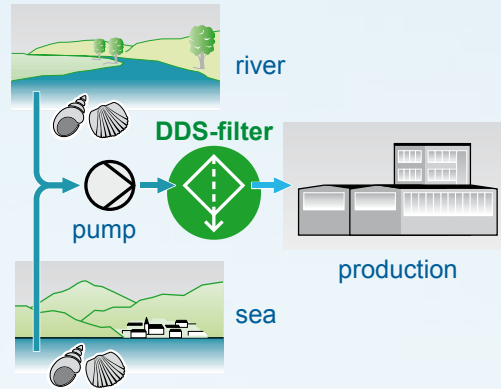

mussel filtration

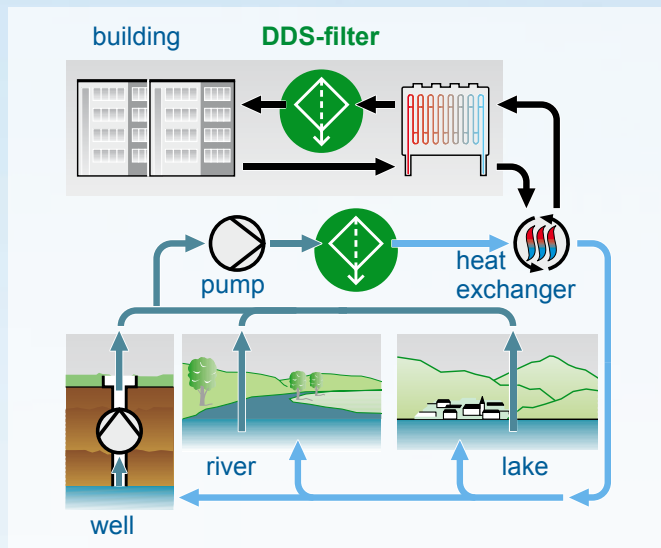

filter for building installations



DANGO & DIENENTHAL
Incorporated

P.O. Box 2870 • Alliance OH 44601

Phone 330 829 0277 • Fax 330 829 1442 • E-mail: filter@dango-dienenthal.com

www.dds-filter.com